






**Grandlite®**  
HIGH POWER LIGHTING SYSTEM  
**LED Dusk to Dawn**  
**LED-742**

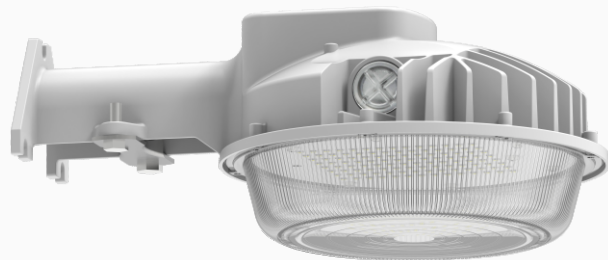

Line Drawing

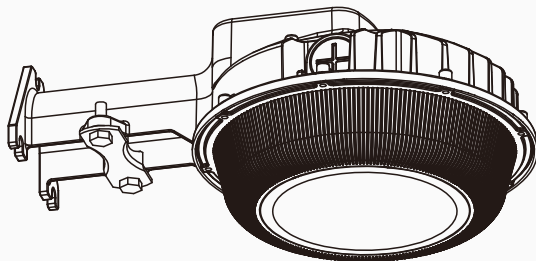

Dimensions

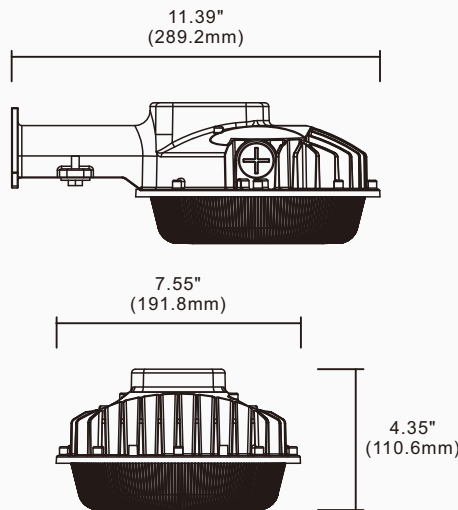

**Product Description:**

Dusk to dawn fixture of the future is here. Utilizing a single source LED, this dusk to dawn fixture provides prismatic designed light output for any environment. An optional Nema approved photocontrol allows for significant power savings. Using the latest generation of LEDs while keeping all the strengths of the traditional dusk to dawn features such as easy bracket and arm installation, this LED dusk to dawn will last for years to come.

Optional mounting and Kelvin color\* with adder.

**Features:**

**LISTING**

UL and CUL listed for wet locations

**HOUSING**

Solid construction die-cast aluminum body

**FINISH**

UV stabilized powder coated finish

**OPTIONS**

Uniform light distribution

Finish - Gray. Color option with adder

Meets DLC 5.1 Requirements




\* Different LED Kelvin temperature available with 4-6 week lead time. Please call for a quote.  
\*\* DISCLAIMER: This test report was produced in accordance with IES LM-79 photometric testing protocol for luminaires, using a single representative test fixture. Actual production units may vary from the values reported here by up to ±10%.



**Grandlite®**  
HIGH POWER LIGHTING SYSTEM  
**LED Dusk to Dawn**  
**LED-742**

**Product Description:**

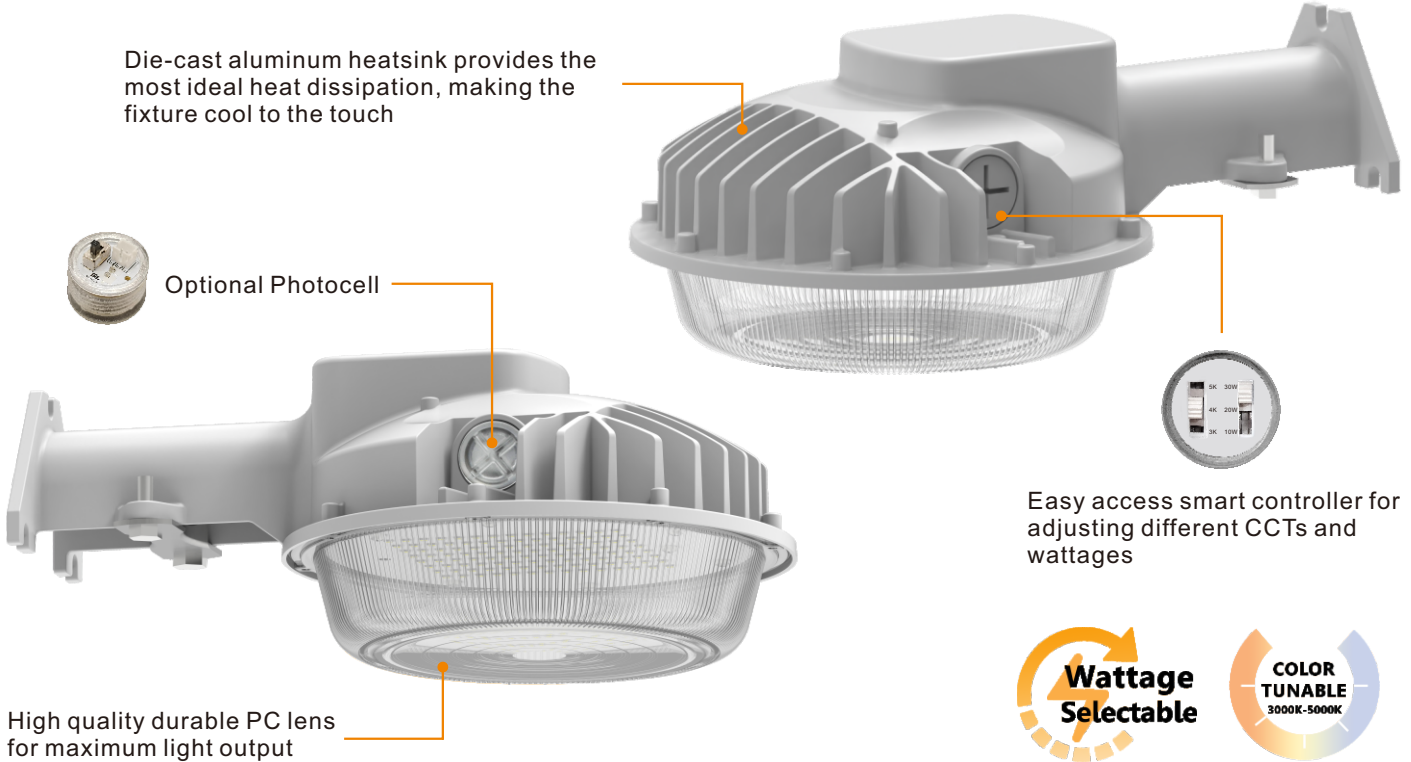

**Performance Data:**

Model No.	Nominal Watts	Lumen*	Efficacy*
LED-742	30/20/10W	4209 lm*	132 lm/w*

\*Lumen and efficacy are based on 5000K highest wattage

**Specification:**

Example:LED-742VA030UNV7TXT5ST-XXXXXX

Model No	Nominal Watts*	Input Voltage	CRI	Color Temp*	Distribution	Option	Finish	Starting Temp
LED-742	030=30W	UNV=120-277VAC	7=70+	TX=3000K 4000K 5000K	T5=Type V	PC=optional photocontrol	GR=Gray	-40°C

\* Different LED Kelvin temperature available with 4-6 week lead time. Please call for a quote.  
\*\* DISCLAIMER: This test report was produced in accordance with IES LM-79 photometric testing protocol for luminaires, using a single representative test fixture. Actual production units may vary from the values reported here by up to ±10%.

