



Grandlite®

HIGH POWER LIGHTING SYSTEM

LED Dusk to Dawn


LED-762

Product Description:


Dusk to dawn fixture of the future is here. Utilizing a single source LED, this dusk to dawn fixture provides prismatic-designed light output for any environment. It is optional to add a NEMA approved photocontrol which used LED that provides significant power savings. Maintaining all the strengths of the traditional dusk to dawn fixtures such as installation brackets and arms while utilizing the latest generation of LEDs, this LED dusk to dawn will last for years to come.

Optional mounting and Kelvin color* with adder.


Line Drawing

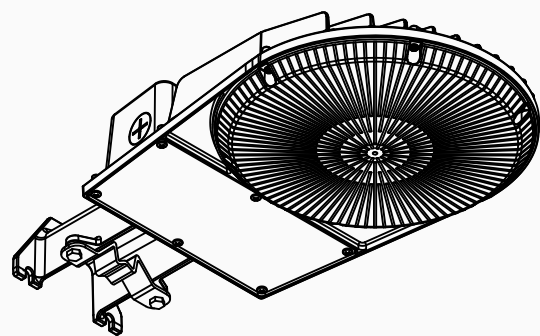

Dimensions

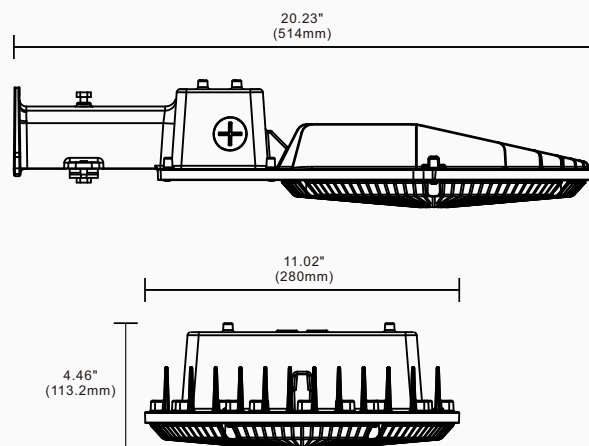

Meets DLC 5.1 Requirements

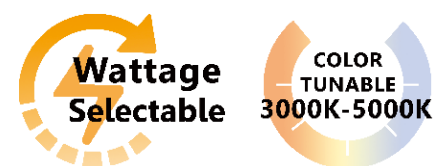

* Different LED Kelvin temperature available with 4-6 week lead time. Please call for a quote.
** DISCLAIMER: This test report was produced in accordance with IES LM-79 photometric testing protocol for luminaires, using a single representative test fixture. Actual production units may vary from the values reported here by up to ±10%.



Grandlite®


HIGH POWER LIGHTING SYSTEM

LED Dusk to Dawn


LED-762

Product Description:

Optional photocontrol

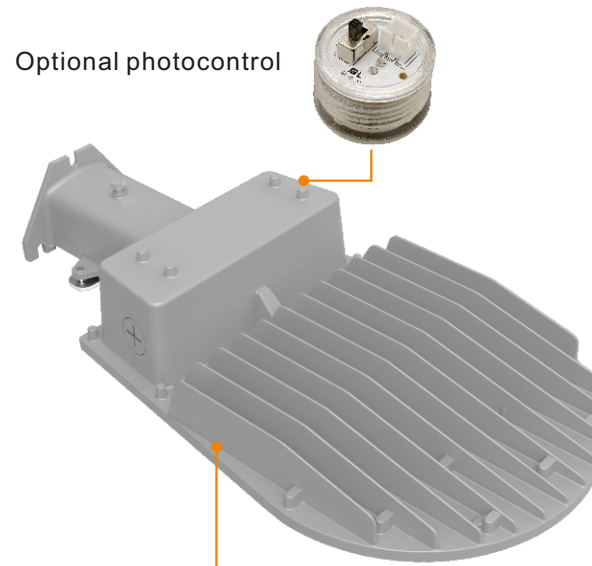

Die-cast aluminum heatsink provides the most ideal heat dissipation, making the fixture cool to the touch



Easy access to the switch for controlling different CCTs



High quality durable PC lens for maximum light output

Performance Data:

Model NO.	Nominal Watts	Lumen*	Efficacy*
LED-762	120/100/80W	15287 lm*	126.7 lm/w*
*Lumen and Efficacy shows the highest wattage at 5000K			

Specification:

Example: LED-762

Model No.	Nominal Watts	Input Voltage	CRI	Color Temp	Distribution	Optional Accessories	Finish	Starting Temp
LED-762	120=120W	UNV=120-277V	7=70+	30=3000 K 40=4000 K 50=5000 K	T5=Type V	PC=optional photocontrol	GR=Gray	-40°C

* Different LED Kelvin temperature available with 4-6 week lead time. Please call for a quote.
** DISCLAIMER: This test report was produced in accordance with IES LM-79 photometric testing protocol for luminaires, using a single representative test fixture. Actual production units may vary from the values reported here by up to ±10%.